

# Weight Indicator Operation Manual



The instruction explain instrument settings, connections,name and etc,please read carefully before you use the temperature controller.

## Safety Caution

### Warning

- 1) If the fault of the product or abnormal system lead to a serious accident, please set appropriate circuit protection outside.
- 2) Before the connection completely, please do not power. Otherwise it may result in electric shock, fire, malfunction.
- 3) Do not use the product out of scope of specifications range. Otherwise, it may result in fire, malfunction.
- 4) Do not use in places with flammable and explosive gas.
- 5) Do not touch the site of high voltage power terminal site after power. Otherwise, there is danger of electric shock.
- 6) Do not disassemble, repair and modify this product. Otherwise, it may result in electric shock, fire, malfunction.

### Caution

- 1) This product should not be used in a nuclear plant and medical equipment which associated with human life.
- 2) Some time, it will happen radio interference when the product uses in home environment, it should take adequate countermeasures.
- 3) This product has electric shock protection through improved insulation. And when using the product and connecting, it subject to compliance with specifications.
- 4) In order to avoid lighting surge, it should set appropriate surge suppression circuits when the product uses in the environment where the total cable length more than 30 metre.
- 5) The product uses in disk, and avoid to touch the part of high voltage, please take the necessary measure on the final product.
- 6) Please observe the precautions in this manual, otherwise there is risk of causing significant harm or accident.
- 7) Please observe the regulation when wiring.
- 8) To prevent to damage the machine and prevent to machine failure, the product is connected with power lines or large capacity input and output lines and other methods please install proper capacity fuse or other methods of protection circuit.
- 9) Please don't put metal and wire elastic mixed with this product, otherwise it may lead to electric shock, fire, fault.
- 10) Please tighten screw torque according to the rules. If not, it may lead to electric shock and fire.
- 11) In order not to interfere with this products to dissipate heat, please don't plug casing around the cooling vent hole and equipment.
- 12) Please don't knock or rub the panel with rigid thing.
- 13) The readers of this manual should have basic knowledge of electrical, control, computer and communications.
- 14) The illustration, example of data and screen in this manual is convenient to understand, instead of guaranteeing the result of the operation.
- 15) In order to use this product with safety for long-term, regular maintenance is necessary. The life of some parts of the equipments are by some restrictions, but the performance of some will change for using many years.
- 16) Without prior notice, the contents of this manual will be change. We hope these is no any loopholes, if you have questions or objections, please contact us.

### Caution of Install & Connection :

#### 1. Installation :

- 1) This product is used in the following environmental standards.  
( IEC61010-1 ) [Overvoltage category II, class of pollution 2]
- 2) This product is used in the following scope: surrounding environment, temperature, humidity and environmental conditions.  
Temperature : 0 ~ 50°C ; Humidity : 45 ~ 85%RH; Environment condition : Indoor warranty, The altitude is less than 2000m.
- 3) Please avoid using in the following places:  
The place will be dew for changing temperature; with corrosive gases and flammable gas; with vibration and impact; with water, oil, chemicals, smoke and steam facilities with Dust, salt, metal powder; and with clutter interference, static electric and magnetic fields, noise; where has air conditioning or heating of air blowing directly to the site.
- 4) On the occasion of the installation, please consider the following before installing several.  
In order to protect heat saturated, please ensure adequate ventilation space.  
Please consider connections and environment, and ensure that the products below for more than 50mm space.  
Please avoid to install over the machine of the calorific value (Such as heaters, transformer, semiconductor operations, the bulk resistance).  
When the surrounding is more than 50°C, please using the force fan or cooling fans. But don't let cold air blowing directly to the product.  
In order to improve the anti - interference performance and security, please try to stay away from high pressure machines, power machines to install.  
Don't install on the same plate with high pressure machine and the product.  
The distance should be more than 200mm between the product and power line.

## Features

- With RS485 communication port , Modbus-RTU
- Power supply : 100-240V AC/DC
- Fully isolated DC10V voltage output (50mA), which can make power supply to sensors
- Support self-calibration function based on your different range.
- One-key reset function ( TARE function )
- Easy to operate , good performance-price ratio

KKWFC02-A/0-20210726


1/14

### 2. Cable caution :

- 1) Please use specified compensation wire in the place of TC input; Please use insulated TC if the measured device is heated metal.
- 2) Please use the cable of lesser resistance in the place of RTD input, and the cable (3 wire) must be no resistance difference, but total length is within 5m.
- 3) In order to avoid the effect of noise, please put the input signal away from meter cable, power cable, load cable to wiring.
- 4) In order to reduce the power cables and the load power cables on the effect of this product, please use noise filter in the place where easy to effect. You must install it on the grounding of the disk if you use the noise filter, and make the wiring to be shortest between noise filter output side and power connectors. Don't install fuse and switch on the wiring of noise filter output side, otherwise it will reduce the effect of noise filter.
- 5) It takes 5s from input power to output. If there is a place with interlocking actions circuit signal, please use timer relay.
- 6) Please use twisted pair with a shield for analog output line, to ensure the reliability of signal.
- 7) Please use twisted pair with a shield for remote RS485 communication cable, and deal with the shield on the host side earth, otherwise it will reduce the effect of noise filter.
- 8) This product is not the fuse; please set according to rated voltage 250V, rated current 1A if you need; fuse type: relay fuse.
- 9) Please use the suitable screw force and crimp terminal.  
The screw terminal size : M4X8 ( with 7.0X7.0 square base )  
Recommended tightening torque : 0.7N.m  
Proper cables : 0.25 ~ 1.65mm single cable/multiple core cable
- 10) Please don't put the Crimp terminal or bare wire part contact with adjacent connector.

Current output	DC 4 ~ 20mA load < 500Ω
Communication port	RS485 port Modbus-RTU protocol, maximum input: 30 units
Insulation impedance	Input, output, power cabinet > 20MΩ
ESD	IEC/EN61000-4-2 Contact ±4KV /Air ±8KV perf. Criteria B
Pulse triap anti-interference	IEC/EN61000-4-4 ±2KV perf. Criteria B
Lightning surge	IEC/EN61000-4-5 ±2KV perf. Criteria B
Frequency drop	IEC/EN61000-4-29 0% ~ 70% perf. Criteria B
Dielectric strength	Signal input & output & power 1500VAC 1min, below 60V Low voltage circuit between DC500V, 1min
Total weight	About 400g
Enclosure material	The enclosure and panel frame PC/ABS (Flame Class UL94V-0)
Panel stick material	PET(F150/F200)
Power-off data protection	10 years , times of writing: 100w times
Protection level of panel	IP65(IEC60529)
Safety Standard	IEC61010-1 Overvoltage category II , pollution level 2 , level III( Enhanced insulation )

## I . Model Illustration

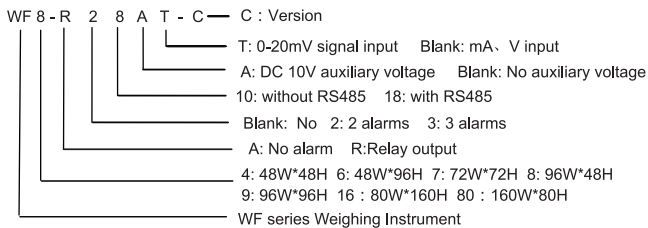

## II . Model List

Model	Signal input	Alarm	Auxiliary voltage	Analog output	RS485
WF□-R20A	mA, V	2	•		
WF□-R28A	mA, V	2	•		•
WF□-R20AT	mV	2	•		
WF□-R28AT	mV	2	•		•

## III . Specification


### 1. Electrical parameters

Sample rate	4SPS
Relay capacity	AC 250V /3A life of rate load>10W times
Power supply	AC/DC 100 ~ 240V ( 85-265V )
Power consumption	<6VA
Environment	Indoor, temperature: 0 ~ 50°C ; Humidity: < 85%RH; Altitude<2000m
Storage environment	-10 ~ 60°C, no condensation

### 2. Signal parameters


Input	Symbol	Range	ratio	Accuracy	Input impedance/auxiliary current	Code
0 ~ 50mV		-1999 ~ 9999	0.01%FS	0.5%FS±3digits	>500KΩ	12
0 ~ 400Ω		-1999 ~ 9999	0.01%FS	0.5%FS±3digits	0.2mA	13
0 ~ 10V		-1999 ~ 9999	0.01%FS	0.5%FS±3digits	>500KΩ	14
4 ~ 20mA		-1999 ~ 9999	0.01%FS	0.5%FS±3digits	100Ω	15
0 ~ 5V		-1999 ~ 9999	0.02%FS	1%FS±3digits	>500KΩ	16
1 ~ 5V		-1999 ~ 9999	0.02%FS	1%FS±3digits	>500KΩ	17
0 ~ 20mA		-1999 ~ 9999	0.01%FS	0.5%FS±3digits	100Ω	18

### 3. Isolation diagram

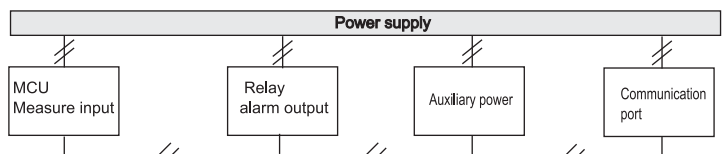

"//": Isolation

#### IV. Name of universal panel

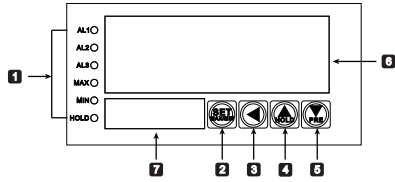


No.	Symbol	Name	Function
1	AL1	Alarm 1 indicator light	1st alarm output indication, alarm output with light, no alarm output without light
	AL2	Alarm 2 indicator light	2nd alarm output indication, alarm output with light, no alarm output without light
	AL3	Alarm 3 indicator light	3rd alarm output indication, alarm output with light, no alarm output without light
	MAX	Light of max value	when the MAX value indicator lighting , PV display the maximum value
	MIN	Light of min value	when the MIN value indicator lighting , PV display minimum value.
	HOLD	Light of hold value	when HOLD value indicator lighting , PV display hold value.
	2	SET	SET key
3	Shift	Shift key	Parameters modify activating , modify bit moves to left
4	▲	Add/hold key	Increase the flashing value, hold measuring the instantaneous value
5	▼	Reduce/reverse key	Reduce the flashing value, reverse to browse menu.
6	PV	Upper display window	Display current/max/min value and parameter symbol, error remind
7	SV	Lower display window	Display measure unit, parameter and alarm value

#### V. Unit symbol comparison

No.	Symbol	Unit	No.	symbol	Unit	No.	symbol	Unit
0	-	no	11	N	N	22	KV	KV
1	M	M	12	W	W	23	mA	mA
2	cm	cm	13	KW	KW	24	A	A
3	mm	mm	14	RPM	RPM	25	KA	KA
4	kg	kg	15	RPS	RPS	26	Ω	Ω
5	g	g	16	MPM	MPM	27	KΩ	KΩ
6	mg	mg	17	MPS	MPS	28	°C	°C
7	Mpa	Mpa	18	Hz	Hz	29	°F	°F
8	pa	pa	19	KHz	KHz	30	K	K
9	ba	ba	20	mV	mV			
10	mba	mba	21	V	V			


#### VI. Operation and Menu Direction

##### 1. Operation of normal menu and shielding menu

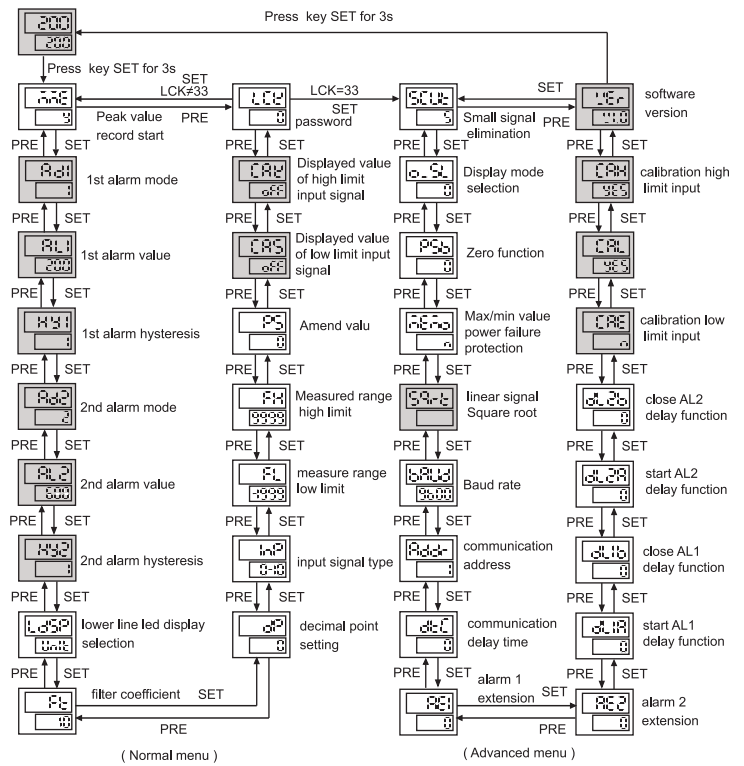

(Normal menu)

(Advanced menu)

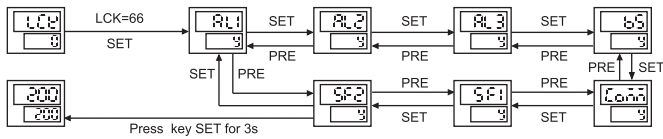

Menu shield function, function symbol and its according parameters are as below:

AL1: AD1, AL1, HY1, AE1, DL1A, DL1B; COMM: BAUD, ADDR, DTC;  
 AL2: AD2, AL2, HY2, AE2, DL2A, DL2B; SF1: CAS, CAK, SQRT;  
 AL3: AD3, AL3, HY3, AE3, DL3A, DL3B; SF2: DREF, STEP, CJC, RLMR  
 BS: BRL, BRH, OLL, OLH, TEST;

When it display function symbol , lower line will display "Y" or "N" (Y means start the function; N means stop the function)  
 For example:if the meter have no first alarm , please set the AL1 to "N" and then exit menu.  
 Then the menu and submenu will not display AD1, AL1, HY1, AE1, DL1A, DL1B and the alarm function stop to work.

- 1) In normal measurement mode and when the MME=Y, press SET key can shift display of max/min/current value in cycle.
- 2) Enter MME menu, set it as displays "Y", press ▲ key to restart to record max/min value.
- 3) In the normal measurement mode, short press ▲ key can lock current display value, and press again to unlock.
- 4) When using CAS/CAK calibration , long press ▲ + ▼ , (make sure PSB=0)

##### 2. Normal menu illustration

No.	Symbol	Name	Specification	Setting range	Default
1	MME	MME	Max/min value for starting record function.Y:start,N:close	0 ( N ) 1 ( Y )	N
2	AD1	AD1	Optional 4types alarm,0:alarm close;L:low limit alarm; H:high limit alarm;Int:interval alarm; Out:outside the interval alarm	0, L, H, Int, Out	L
3	AL1	AL1	1st alarm setting value	FL-FH	200
4	AH1	AH1	1st alarm interval high limit value	FL-FH	1000
5	HY1	HY1	1st alarm hysteresis value	0~1000	1
6	AD2	AD2	Optional 4 types alarm , set as 0 , alarm close	0, L, H, Int, Out	H
7	AL2	AL2	2nd alarm setting value	FL-FH	600
8	AH2	AH2	2nd alarm interval high limit value	FL-FH	1000
9	HY2	HY2	2nd alarm hysteresis value	0~1000	1
10	AD3	AD3	Optional 4 types alarm , set as 0 , alarm close	0, L, H, Int, Out	H
11	AL3	AL3	3rd alarm setting value	FL-FH	800
12	AH3	AH3	3rd alarm interval high limit value	FL-FH	1000
13	HY3	HY3	3rd alarm hysteresis value	0~1000	1
14	LDSP	LDSP	lower line led display selection : no display, measuring unit , 1st/2nd/3rd alarm value.	Non, Unit, AL1, AL2, AL3	Unit
15	FT	FT	filter coefficient of digital filters. The higher of value, the larger the filter effect.	1~255	10
16	DREF	DREF	Display refresh cycle, unit:s	0~5	0
17	DP	DP	decimal point setting for linear signal	0~3	0
18	INP	INP	Input signal types	Refer to signal sheet page 3	0~10V/K

19	FL	FL	measure range low limit ,setting value must be less than range high limit	Refer to signal sheet page 3	0/-50
20	FH	FH	Measured high limit , setting value must larger than measured low limit	Refer to signal sheet page 3	1000/1200
21	PS	PS	Amend value,display value=actual measured value+ amend value	-1999~9999	0
22	CAS	CAS	Display value of low limit input set corresponding value of low limit input. press ▼ to decrease CAS value.when CAS= OFF , this function is disabled.	OFF, FL - FH	OFF
23	CAK	CAK	Displayed value of high limit input. Set corresponding value of high limit input , press ▼ to decrease CAK value, when CAK= OFF , this function is disabled.	OFF, FL - FH	OFF
24	LCK	LCK	Password ,LCK=01, unit lock ; LCK=10, menu lock; LCK=11, unit&menu lock; LCK=33, it can enter class 2 menu; LCK=5555, reset to factory setting.	0~9999	0

##### 3. Advanced menu illustration

25	SCUT	SCUT	Small signal elimination function, please refer to o_SL	-1999~9999	5
26	o_SL	o_SL	Display mode choice , o_SL=0, no function . o_SL=1, measured value <FL, display FL value ; measured value >FH, display FH value. o_SL=2, measured value < SCUT/FL, display FL ; measured value > FH, display FH value o_SL=3,measured value <SCUT, display smaller value of FL&SCUT; if measure value >FH, display FH value.	0~3	0
27	PSB	PSB	Zero function, long press ▲ + ▼ , display will show zero. And then zero value is stored in PSB. If you want to reset value, long press ▲ + ▼ or set PSB as 0	-1999~9999	0
28	MEMO	MEMO	Max/min value power failure protection.Y : open ; N:Close	0 ( N ) 1 ( Y )	N
29	SQRT	SQRT	linear signal Square root	0 ( N ) 1 ( Y )	N
30	STEP	STEP	Display jumping interval	1~10	1
31	BRL	BRL	transmission output low limit	FL-FH	FL
32	BRH	BRH	transmission output high limit	FL-FH	FH
33	OLL	OLL	Adjust transmission output low limit OLL= (preset transmission low limit - actual transmit low limit) / actual transmission range*1000	-500~1000	0
34	OLH	OLH	Adjust transmission output high limit OLH= (preset transmit high limit - actual transmission high limit) / actual transmission range *1000+1000	0~1050	1000
35	BAUD	BAUD	Communication baud rate	4.8K, 9.6K, 19.2K	9.6K
36	ADDR	ADDR	Meter communication address	1~255	1
37	DTC	DTC	Communication delay time	Refer remarks(page 14)	0
38	AE1	AE1	AL1 extensions	0~11	0
39	AE2	AE2	AL2 extensions	0~11	0
40	AE3	AE3	AL3 extensions	0~11	0


41	DL1A	DL1A	start the function AL1 delay(unit:s)	0~999.9	0.0
42	DL1B	DL1B	close the function of AL1 delay(unit:s)	0~999.9	0.0
43	DL2A	DL2A	start the function of AL2 delay (unit:s)	0~999.9	0.0
44	DL2B	DL2B	close the function of AL2 delay(unit:s)	0~999.9	0.0

\*\*Example of Weighing application :


If use 50kg load cell , expect to display 0.00kg before adding the weight , and display 20kg when weighing 20kg material. please make operation as below:

1) set parameter DP=2, INP =  $\frac{1}{10}$ , FL=0, FH=9999.9

2) Firstly, set CAS=0 before putting weight, Secondly put the 20kg weight and then setting parameter CAK=20.00 . Finally, exit the menu to realize the accurate display within 0~50kg.

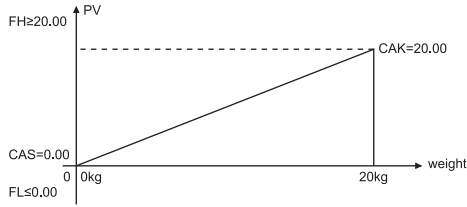


## VII. Wire guidance of weighing sensor

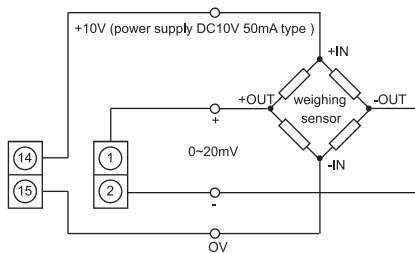

8/14


## VIII. Alarm parameters and output logic diagram

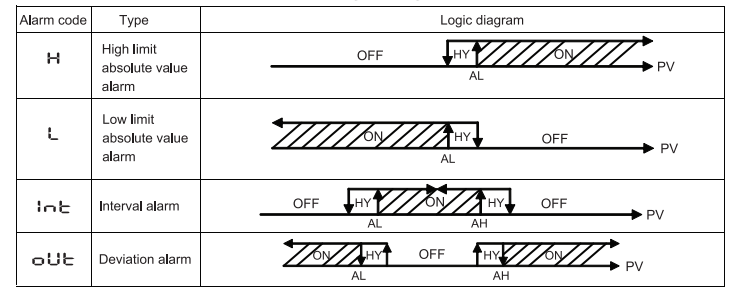

Alarm extension function table

AE1/AE2/AE3 value	Alarm handling mode when show over limit	inhibits alarms or not when power on	Alarm control accuracy
0	Status maintained	Do not inhibit	Alarm control with highest resolution of the meter
1	Forced alarm output	(As long as it meets the requirement of alarm, alarm output)	
2	Forced alarm close	Inhibit	
3	Status maintained	(Forced alarm close when power on; alarm does not output until PV meet alarm condition)	
4	Forced alarm output	Do not inhibit	Alarm control with display resolution
5	Forced alarm close	(As long as it meets the requirement of alarm, alarm output)	
6	Status maintained	Inhibit	
7	Forced alarm output	(Forced alarm close when power on; alarm does not output until PV meet alarm condition)	
8	Forced alarm close		
9	Status maintained		
10	Forced alarm output		
11	Forced alarm close		


## IX. Dimension

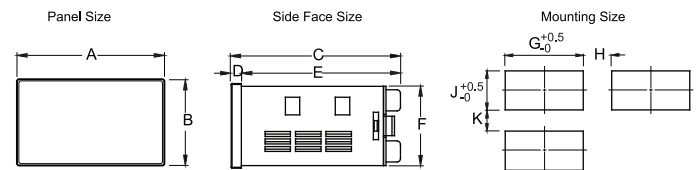

Model	A	B	C	D	E	F	G	H(Min)	J	K(Min)
3:(72*36)	72	36	70.5	6.5	64	32	68	25	33	25
4:(48*48)	48	48	101	10	91	45	45.5	25	45.5	25
6:(96*48)	48	96	100	6	94	91	45.5	25	91.5	25
7:(72*72)	72	72	100	10	90	67.5	68	25	68	25
8:(48*96)	96	48	100	6	94	45	91.5	25	45.5	25
9:(96*96)	96	96	100	10	91	90.5	91	25	91	25
80:(80*160)	160	80	102	10	92	76	154	30	76.5	30
16:(160*80)	80	160	102	10	92	153.5	76.5	30	154	30

9/14

## X. Connection drawing

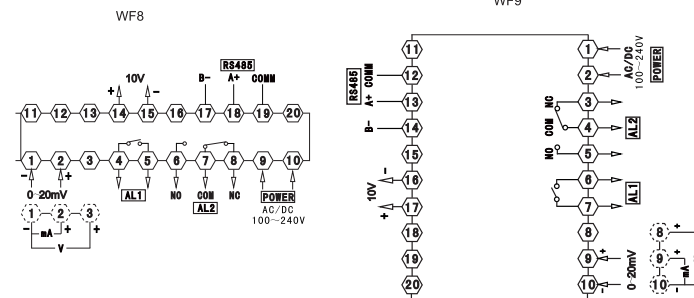

Note: please kindly subject to the actual product connecting drawing if any change.

## X I .Methods of simple fault

Display	Methods
HHHH/LLLL	Checks whether the input signal connects or not, whether the figure of FH/FL value is too small, whether input signal is selected correctly, whether working environment is normal.

## X II .Communication protocol

Meter adopt Modbus RTU communication protocol, RS485 half duplex communication. Read function code: 0x03, write function code 0x06 or 0x10. Adopts 16 digit CRC check, the meter does not return for error check. Data frame format:

Start bit	Data bit	Stop bit	Check bit
1	8	1	No

Abnormal communication processing:

When abnormal response , put 1 on the highest bit of function code. For example: when host request function code is 0x03, slave response function code should be 0x83.

Error code:

0x02~ illegal address: the register address designated by host beyond the address range of meter.

Communication cycle:

Communication cycle is the time from host request to slave response data . ie: communication cycle= time of request data sending +slave preparation time + response delay time + response return time.

Eg: 9600 Baud rate: communication cycle of single measured data ≥ 250ms.

1 Read register ( 0x03 )

For example: Host reads integer AL1 ( AL1=200 )

The address code of AL1 is 0x3201, because AL1 is integer ( 2 byte), seizes 1 data register. The memory code of decimal integer 200 is 0x00C8.

Note:It should read DP value or confirm DP menu value first to ensure the decimal point position when reading data,and converse the reading data to get the actual value. On the contrary ,it should converse the data to corresponding ratio first before writing the data into meter.

10/14

Host request ( Read multi-register )							
1	2	3	4	5	6	7	8
Meter ADD	Function code	Start ADD High bit	Start ADD Low bit	Data byte length high bit	Data byte length low bit	CRC code low bit	CRC code high bit
0x01	0x03	0x32	0x01	0x00	x01	0x DB	0x72

Slave normal answer ( Read multi-register )						
1	2	3	4	5	6	7
Meter ADD	Function code	Data byte number	Data high bit	Data low bit	CRC code low bit	CRC code high bit
0x01	0x03	0x02	0x00	0xC8	0xB9	0xD2

Address error abnormal answer: (For example, host request address is 0x2101)

Slave error answer				
1	2	3	4	5
Meter ADD	Function code	Error code	CRC code low bit	CRC code high bit
0x01	0x83	0x02	0xC0	0xF1

2 Write multi-register (0x06)

For example: Host writes AL1 ( First alarm set value 100 )

The address code of AL1 is 0x3201, because AL1 is integer ( 2 byte), seizes 1 data register. The hexadecimal memory code of decimal integer 100 is 0x0064.

Host request ( Write single-register )							
1	2	3	4	5	6	7	8
Meter ADD	Function code	Data ADD High bit	Data ADD Low bit	Data High bit	Data Low bit	CRC code low bit	CRC code high bit
0x01	0x06	0x32	0x01	0x00	0x64	0xD7	0x59

Slave normal answer ( Write single-register )							
1	2	3	4	5	6	7	8
Meter ADD	Function code	Data ADD High bit	Data ADD Low bit	Data High bit	Data Low bit	CRC code low bit	CRC code high bit
0x01	0x06	0x32	0x01	0x00	0x64	0xD7	0x59

3. Write register ( 0x10 )

For example: host writes AL1 (First alarm set value 100)

Host request ( Write register )										
1	2	3	4	5	6	7	8	9	10	11
Meter ADD	Function code	Start ADD High bit	Start ADD Low bit	Data byte length high bit	Data byte length low bit	Data byte length	Data high bit	Data low bit	CRC code low bit	CRC code high bit
0x01	0x10	0x32	0x00	0x00	0x01	0x02	0x00	0x64	0xB5	0xA9

11/14

Slave normal answer ( Write register )							
1	2	7	4	5	6	7	8
Meter ADD	Function code	Start ADD High bit	Start ADD Low bit	Data byte length high bit	Data byte length low bit	CRC code low bit	CRC code high bit
0x01	0x10	0x32	0x01	0x00	0x01	0x5E	0xB1

Data location error response:(For example:Host request write ADD index is 0x2100)

Slave answer error code				
1	2	3	4	5
Meter ADD	Function code	Error code	CRC code low bit	CRC code high bit
0x01	0x90	0x02	0xCD	0xC1

4. Address Mapping Table of Meter Parameters

No.	ADD mapping	Variable name	Register number	Read/write	Remark
1	0x3000	PV Measure value	2	R	match DP setting to read value
2	0x3001	MAX Maximum measure value	2	R	match DP setting to read value
3	0x3002	MIN Minimum measure value	2	R	match DP setting to read value
4	0x3003	HOLD Hold measured value	2	R	match DP setting to read value
5	0x3004	STA Output status word	2	R	Note①(Page 14)
Reserve					
6	0x3100	FL Measuring range low limit	2	R/W	match DP setting to read value
7	0x3101	FH Measuring range high limit	2	R/W	match DP setting to read value
8	0x3102	INP Input signal type	2	R/W	Refer to measure signal parameter table(Page 3)
9	0x3103	DP Decimal point	2	R/W	Effective for all quantities-related parameter
10	0x3104	UNIT Unit setting	2	R/W	Refer to unit symbol table (Page 4)
11	0x3105	Amend value	2	R/W	match DP setting to read value
12	0x3106	CAS Display value of low limit input	2	R/W	Set the low input point corresponding display value
13	0x3107	CAK Display value of high limit input	2	R/W	Set the high input point corresponding display value
14	0x3108	FT Filter constants	2	R/W	1~255
15	0x3109	DREF Display refresh cycle	2	R/W	Unit: second
16	0x310A	SCUT Small Signal Elimination	2	R/W	match DP setting to read value
17	0x310B	PSb Zero clearing value	2	R/W	match DP setting to read value
18	0x310C	oSL Display mode selection	2	R/W	Refer to menu illustration (Page 7)
19	0x310D	LDSP lower line led display selection	2	R/W	Non(0), Unit(1), AL1(2), AL2(3), AL3(4)
20	0x310E	STEP Display jumping interval	2	R/W	Set the minimum step value of display change
21	0x310F	MME Maximum/minimum value record function	2	R/W	0:N ; 1:Y
22	0x3110	MEMO Power failure memory	2	R/W	0:N ; 1:Y

23	0x3111	SQRT Linear signal square root	2	R/W	0:N ; 1:Y
24	0x3112	CJC Thermocouple cold end compensation method	2	R/W	-1: Auto compensation, 0: No compensation, (1~50) Manual input cold end temperature
25	0x3113	RLMR linear resistance value	2	R/W	Unit: mΩ

Reserve					
26	0x3200	AD1 1st alarm type	2	R/W	0:no alarm, 1:L, 2:H, 3:Int., 4:Out
27	0x3201	AL1 1st alarm value	2	R/W	FL~FH match DP setting to read value
28	0x3202	AH1 1st interval alarm high limit value	2	R/W	FL~FH match DP setting to read value
29	0x3203	HY1 1st alarm hysteresis value	2	R/W	0~1000 match DP setting to read value
30	0x3204	AE1 1st alarm extension	2	R/W	Refer to alarm extension table (Page 9)
31	0x3205	DL1A start the function AL1 delay	2	R/W	10 corresponding to 1.0 second
32	0x3206	DL1B close the function AL1 delay	2	R/W	10 corresponding to 1.0 second
33	0x3207	AD2 2nd alarm type	2	R/W	0:no alarm, 1:L, 2:H, 3:Int., 4:Out
34	0x3208	AL2 2nd alarm value	2	R/W	FL~FH match DP setting to read value
35	0x3209	AH2 2nd interval alarm high limit value	2	R/W	FL~FH match DP setting to read value
36	0x320A	HY2 2nd alarm hysteresis value	2	R/W	0~1000 match DP setting to read value
37	0x320B	AE2 2nd alarm extension	2	R/W	Refer to alarm extension table (Page 9)
38	0x320C	DL2A start the function AL1 delay	2	R/W	10 corresponding to 1.0 second
39	0x320D	DL2B close the function AL1 delay	2	R/W	10 corresponding to 1.0 second
40	0x320E	AD3 3rd alarm type	2	R/W	0:no alarm, 1:L, 2:H
41	0x320F	AL3 3rd alarm value	2	R/W	FL~FH match DP setting to read value
42	0x3210	AH3 3rd interval alarm high limit value	2	R/W	FL~FH match DP setting to read value
43	0x3211	HY3 3rd alarm hysteresis value	2	R/W	0~1000 match DP setting to read value
44	0x3212	AE3 3rd alarm extension	2	R/W	refer alarm extension table(page 9)
45	0x3213	DL3A start the function AL1 delay	2	R/W	10 corresponding to 1.0 second
46	0x3214	DL3B close the function AL1 delay	2	R	10 corresponding to 1.0 second
Reserve					
47	0x3301	BRL transmission output low limit	2	R	FL~FH match DP setting to read value
48	0x3302	BRH transmission output high limit	2	R/W	FL~FH match DP setting to read value
49	0x3303	OLL Adjust transmission output low limit	2	R/W	-500~1000
50	0x3304	OLH Adjust transmission output high limit	2	R	0~1050
51	0x3305	TESE simulate input test enable	2	R	0:close, 1:open
52	0x3306	TEST simulate input test	2	R/W	simulate display input, test output function

Reserve					
53	0x3400	LCK Lock	2	R/W	When LCK=11, other parameter can not be written
54	0x3401	ADD Meter communication address	2	R/W	1~255
55	0x3402	BAUD Baud rate	2	R/W	0:4.8K, 1:9.6K, 2:19.2K
56	0x3403	DTC Communication configuration byte	2	R/W	Note②(Page 15)
57	0x3404	NAME meter name	2	R	208: SD8
58	0x3405	VER Software version code	2	R	10 : V1.0

R : Read only ; R/W : Read/Write

Note① measurement status indication, when data byte is 1, it means execution; when data byte is 0, it means no execution.

D7	D6	D5	D4	D3	D2	D1	D0
HHHH	LLLL	MIN	HOLD	MAX	AL3	AL2	AL1

Note② : DTC communication configuration byte illustration

DTC :     One place, respon delay: 0 ~ 9 respectively stand for 10 ~ 100ms  
    Tens place, byte transfer sequence: when it is 0, from high to low; when it is 1, from low to high  
    Hundreds place, reserve

※16 digit CRC check code to get C program

```

unsigned int Get_CRC(uchar *pBuf, uchar num)
{
    unsigned int i;
    unsigned int wCrc = 0xFFFF;
    for(i=0; i<num; i++)
    {
        wCrc ^= (unsigned int)(pBuf[i]);
        for(j=0; j<8; j++)
        {
            if((wCrc & 1){wCrc >>= 1; wCrc ^= 0xA001;}
            else wCrc >>= 1;
        }
    }
    return wCrc;
}

```